


# Cable configuration

## JT-ArCon PV-array-interconnection system 1/2

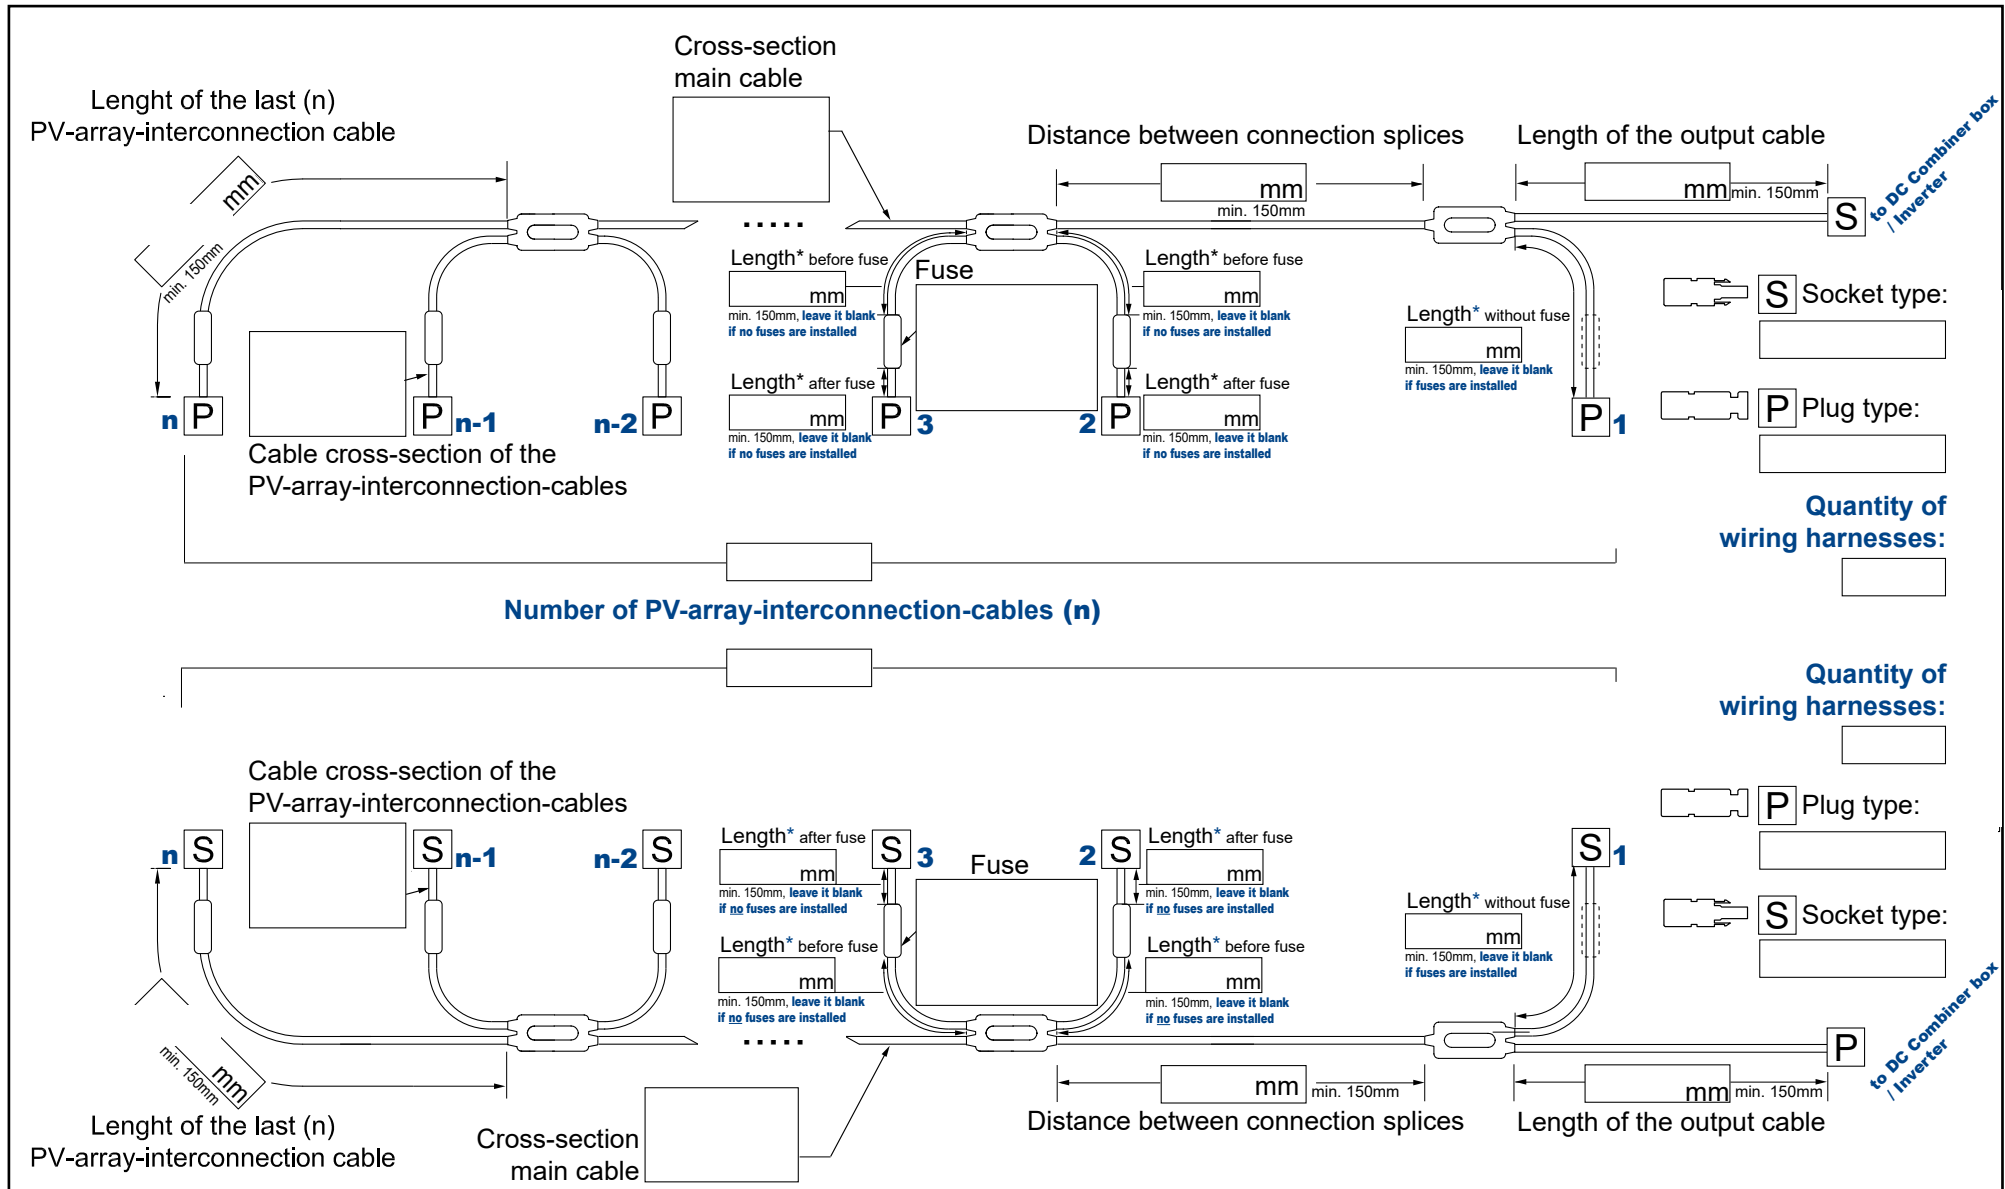

\*: in general, all PV-array-interconnection-cables can be configured in different lengths. In this case, we need this info in addition to this form.

# Cable configuration JT-ArCon PV-array-interconnection system 2/2



Features / Notes:

Customer: \_\_\_\_\_

Deadline: \_\_\_\_\_

Project: \_\_\_\_\_

Specifics: \_\_\_\_\_

FCA factory / Collection by customer  
 CIF via sea freight  
 DAP



Delivery Address (for CIF or DAP)

Recipient Recipient  
(first & last name): \_\_\_\_\_

Street name + house number: \_\_\_\_\_

Post code + town / harbour: \_\_\_\_\_

Country: \_\_\_\_\_

Project manager  
(or applicant) : \_\_\_\_\_